


### ELECTRICAL SYMBOLS

SCR	CONDUIT STUB BTC ON RECEPT FURNISHED WITH EQUIPMENT	CC	CONDUIT FOR COMPUTER CABLES
CS	CONDUIT STUB UP / OUT FOR DIRECT CONNECTION	BTC	BRANCH TO CONNECTION ON EQUIPMENT
DR	20 AMP DUPLEX RECEPTACLE (MOUNT HORIZONTAL)	WPR	20 AMP WEATHERPROOF RECEPTACLE (SPRING COVER)
SR	SINGLE PURPOSE RECEPTACLE	FPB	FIRE PROTECTION BUZZER
SR	SINGLE PURPOSE RECEPTACLE	BSC	BEVERAGE SYSTEM CONDUIT
FR	FLUSH FLOOR RECEPTACLE	DFA	DROP FROM ABOVE
PMR	PEDESTAL MOUNTED RECEPTACLE	AFF	ABOVE FINISH FLOOR
DCR	DROP CORD RECEPTACLE	ST	STUB UP ABOVE FINISHED FLOOR
JB	JUNCTION BOX IN CEILING	JBP	JUNCTION BOX ON PEDESTAL
JB	JUNCTION BOX IN WALL		

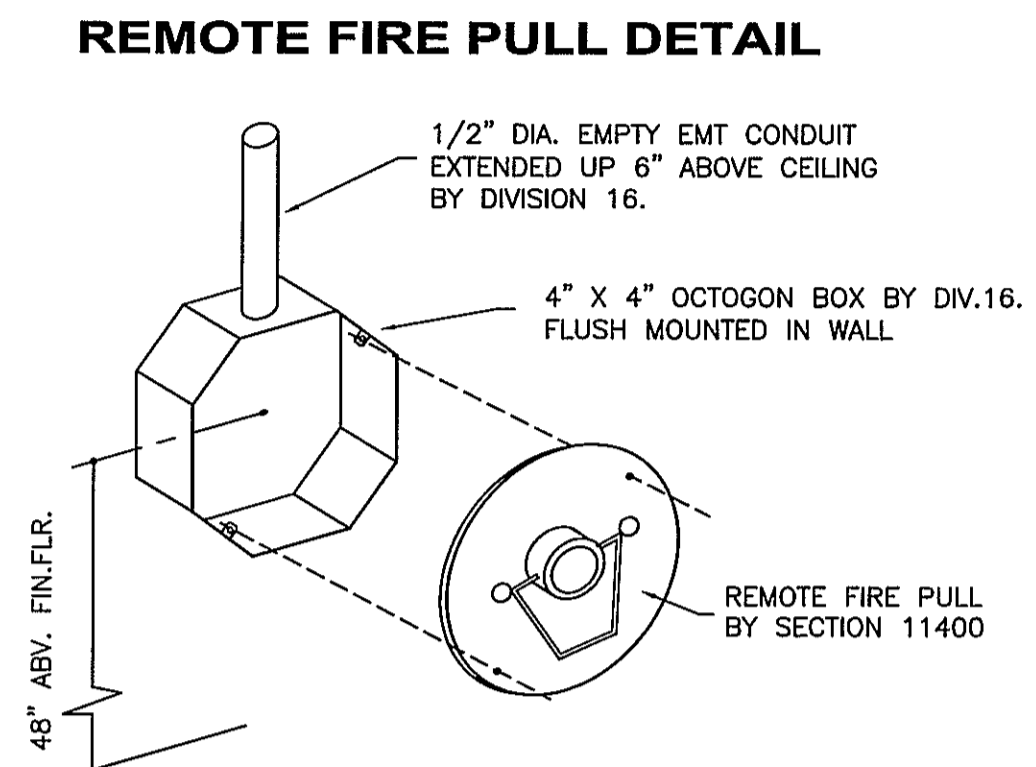


#### ELECTRICAL NOTES

- DO NOT ROUGH-IN FROM THIS DRAWING. REFER TO THE CONTRACTOR'S DIMENSIONED DRAWINGS.
  - VERIFY ALL ELECTRICAL CHARACTERISTIC WITH ARCHITECT'S ENGINEERING DRAWINGS.
  - DIMENSIONS INDICATED ARE TO BE VERIFIED BY CONTRACTOR AND ADJUSTED AS REQUIRED BY FOODSERVICE EQUIPMENT AND / OR FIELD CONDITIONS.
- REFER THE FOLLOWING NOTES TO "HEX" SYMBOLS INDICATED ON "FS" ELECTRICAL CONNECTIONS DRAWINGS:
- CONDUIT AND WIRING BETWEEN LOW TEMPERATURE EVAPORATOR COILS AND CONDENSING UNITS FOR FAN MOTOR AND DEFROST ELEMENT. BTC WITH SEVEN WIRES FROM POWER SOURCE AT CONDENSING UNIT, BY DIVISION 16.
  - EVAPORATOR COIL PREWIRED TO JB MOUNTED ON COMPARTMENT TOP BY SECTION 11400, FINAL CONNECTION BY DIVISION 16.
  - CONTRACTOR RELAYS AT PANEL BOARD BY DIVISION 16 FOR FUEL SHUT-OFF TO ALL ELECTRICALLY CONNECTED EQUIPMENT AND OUTLETS INDICATED ON DRAWINGS BELOW EXHAUST HOOD. RELAYS ACTIVATED BY FIRE SUPPRESSION SYSTEM. RE: FIRE SUPPRESSION SYSTEM DETAIL.
  - WALL SWITCH, CONCEALED CONDUIT AND WIRING TO LIGHT FIXTURES IN EXHAUST HOOD(S) BY DIVISION 16.
  - WALL SWITCH, CONCEALED CONDUIT AND WIRING TO EXHAUST FAN(S) BY DIVISION 16.
  - REMOTE MANUAL PULL STATIONS FOR EXHAUST HOODS : EMPTY OCTAGONAL BOX AT 48" AFF WITH 3/4" DIAMETER EMPTY CONDUIT @ 6" ABOVE CEILING BY DIVISION 16. FIRE PULL AND COVER PLATE FURNISHED AND INSTALLED BY SECTION 11400.
  - CONDUIT AND WIRING FROM EXHAUST HOOD FIRE SUPPRESSION SYSTEM TO ELECTRICAL RELAYS AND ALARM BY DIVISION 16.
  - DR, SR, OR DS AS INDICATED ON DRAWING : FURNISHED AND PREWIRED TO JB OR LOAD CENTER BY SECTION 11400, FINAL CONNECTIONS BY DIVISION 16.

**A** FOODSERVICE ELECTRICAL PLAN  
 FS1.3 SCALE: 1/4"=1'-0"

VERIFY WITH ARCHITECT'S PLANS FOR EXACT LOCATION.

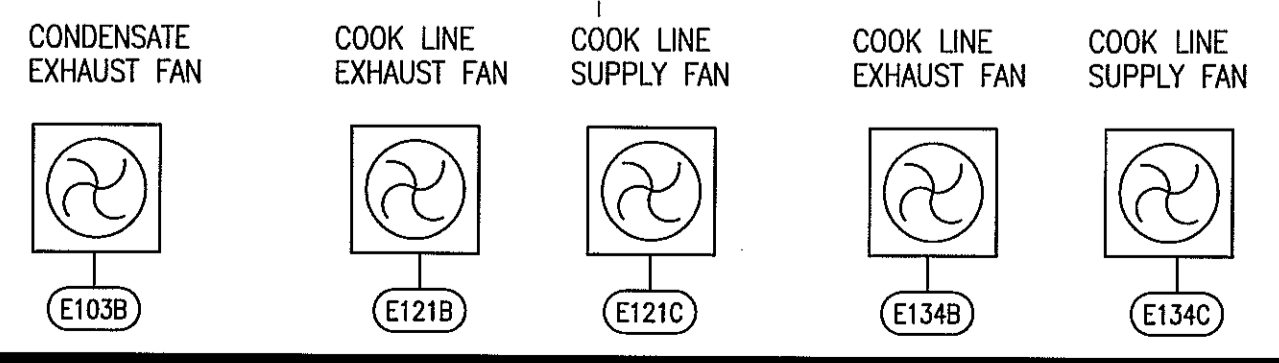

REFER TO FS1.01 FOR ELECTRICAL SCHEDULE

**Cafe Express**  
 3418 NORTH LAMAR BOULEVARD  
 AUSTIN, TEXAS 78705

**Gensler**

711 Louisiana  
 Suite 300  
 Houston, Texas 77002  
 Tel: 713.844.0000  
 Fax: 713.844.0001

**ISI.**  
**Food Service Equipment**

640 WEST 6TH STREET  
 HOUSTON, TX 77007  
 PHONE: 713861-4455

Issue	Date & Issue Description	By	Check
	12/23/09	ISI	Lee C.
ISSUE FOR PERMIT, PRICING & CONSTRUCTION			

Seal/Signature

Project Name  
 CAFE EXPRESS / AUSTIN

Project Number  
 02.6924.001  
 CAD File Name

Description

Scale

**FOODSERVICE EQUIPMENT  
 ELECTRICAL PLAN**

**FS1.3**

©2009 Gensler