


ISSUE
11-30-10 ISSUED FOR PERMIT

- ELECTRICAL KEYED NOTES.**
(FOR SHEET E2.02)
- 1 COORDINATE FINAL MOUNTING HEIGHT OF OUTLET WITH PARAPET WALL FOR TANKLESS GAS WATER HEATER. MAXIMUM HEIGHT SHALL BE AT +48' A.F.F.
 - 2 ROUTE THROUGH TIMELOCK.
 - 3 FINAL CONNECTION TO PRE-WIRED ELECTRICAL PACKAGE PROVIDED BY HOOD MANUFACTURER.
 - 4 COORDINATE EXACT LOCATION OF EQUIPMENT WITH FOOD SERVICE REPRESENTATIVE PRIOR TO INSTALLATION.
 - 5 CONVENIENCE OUTLET PROVIDED WITH CONDENSING UNIT.

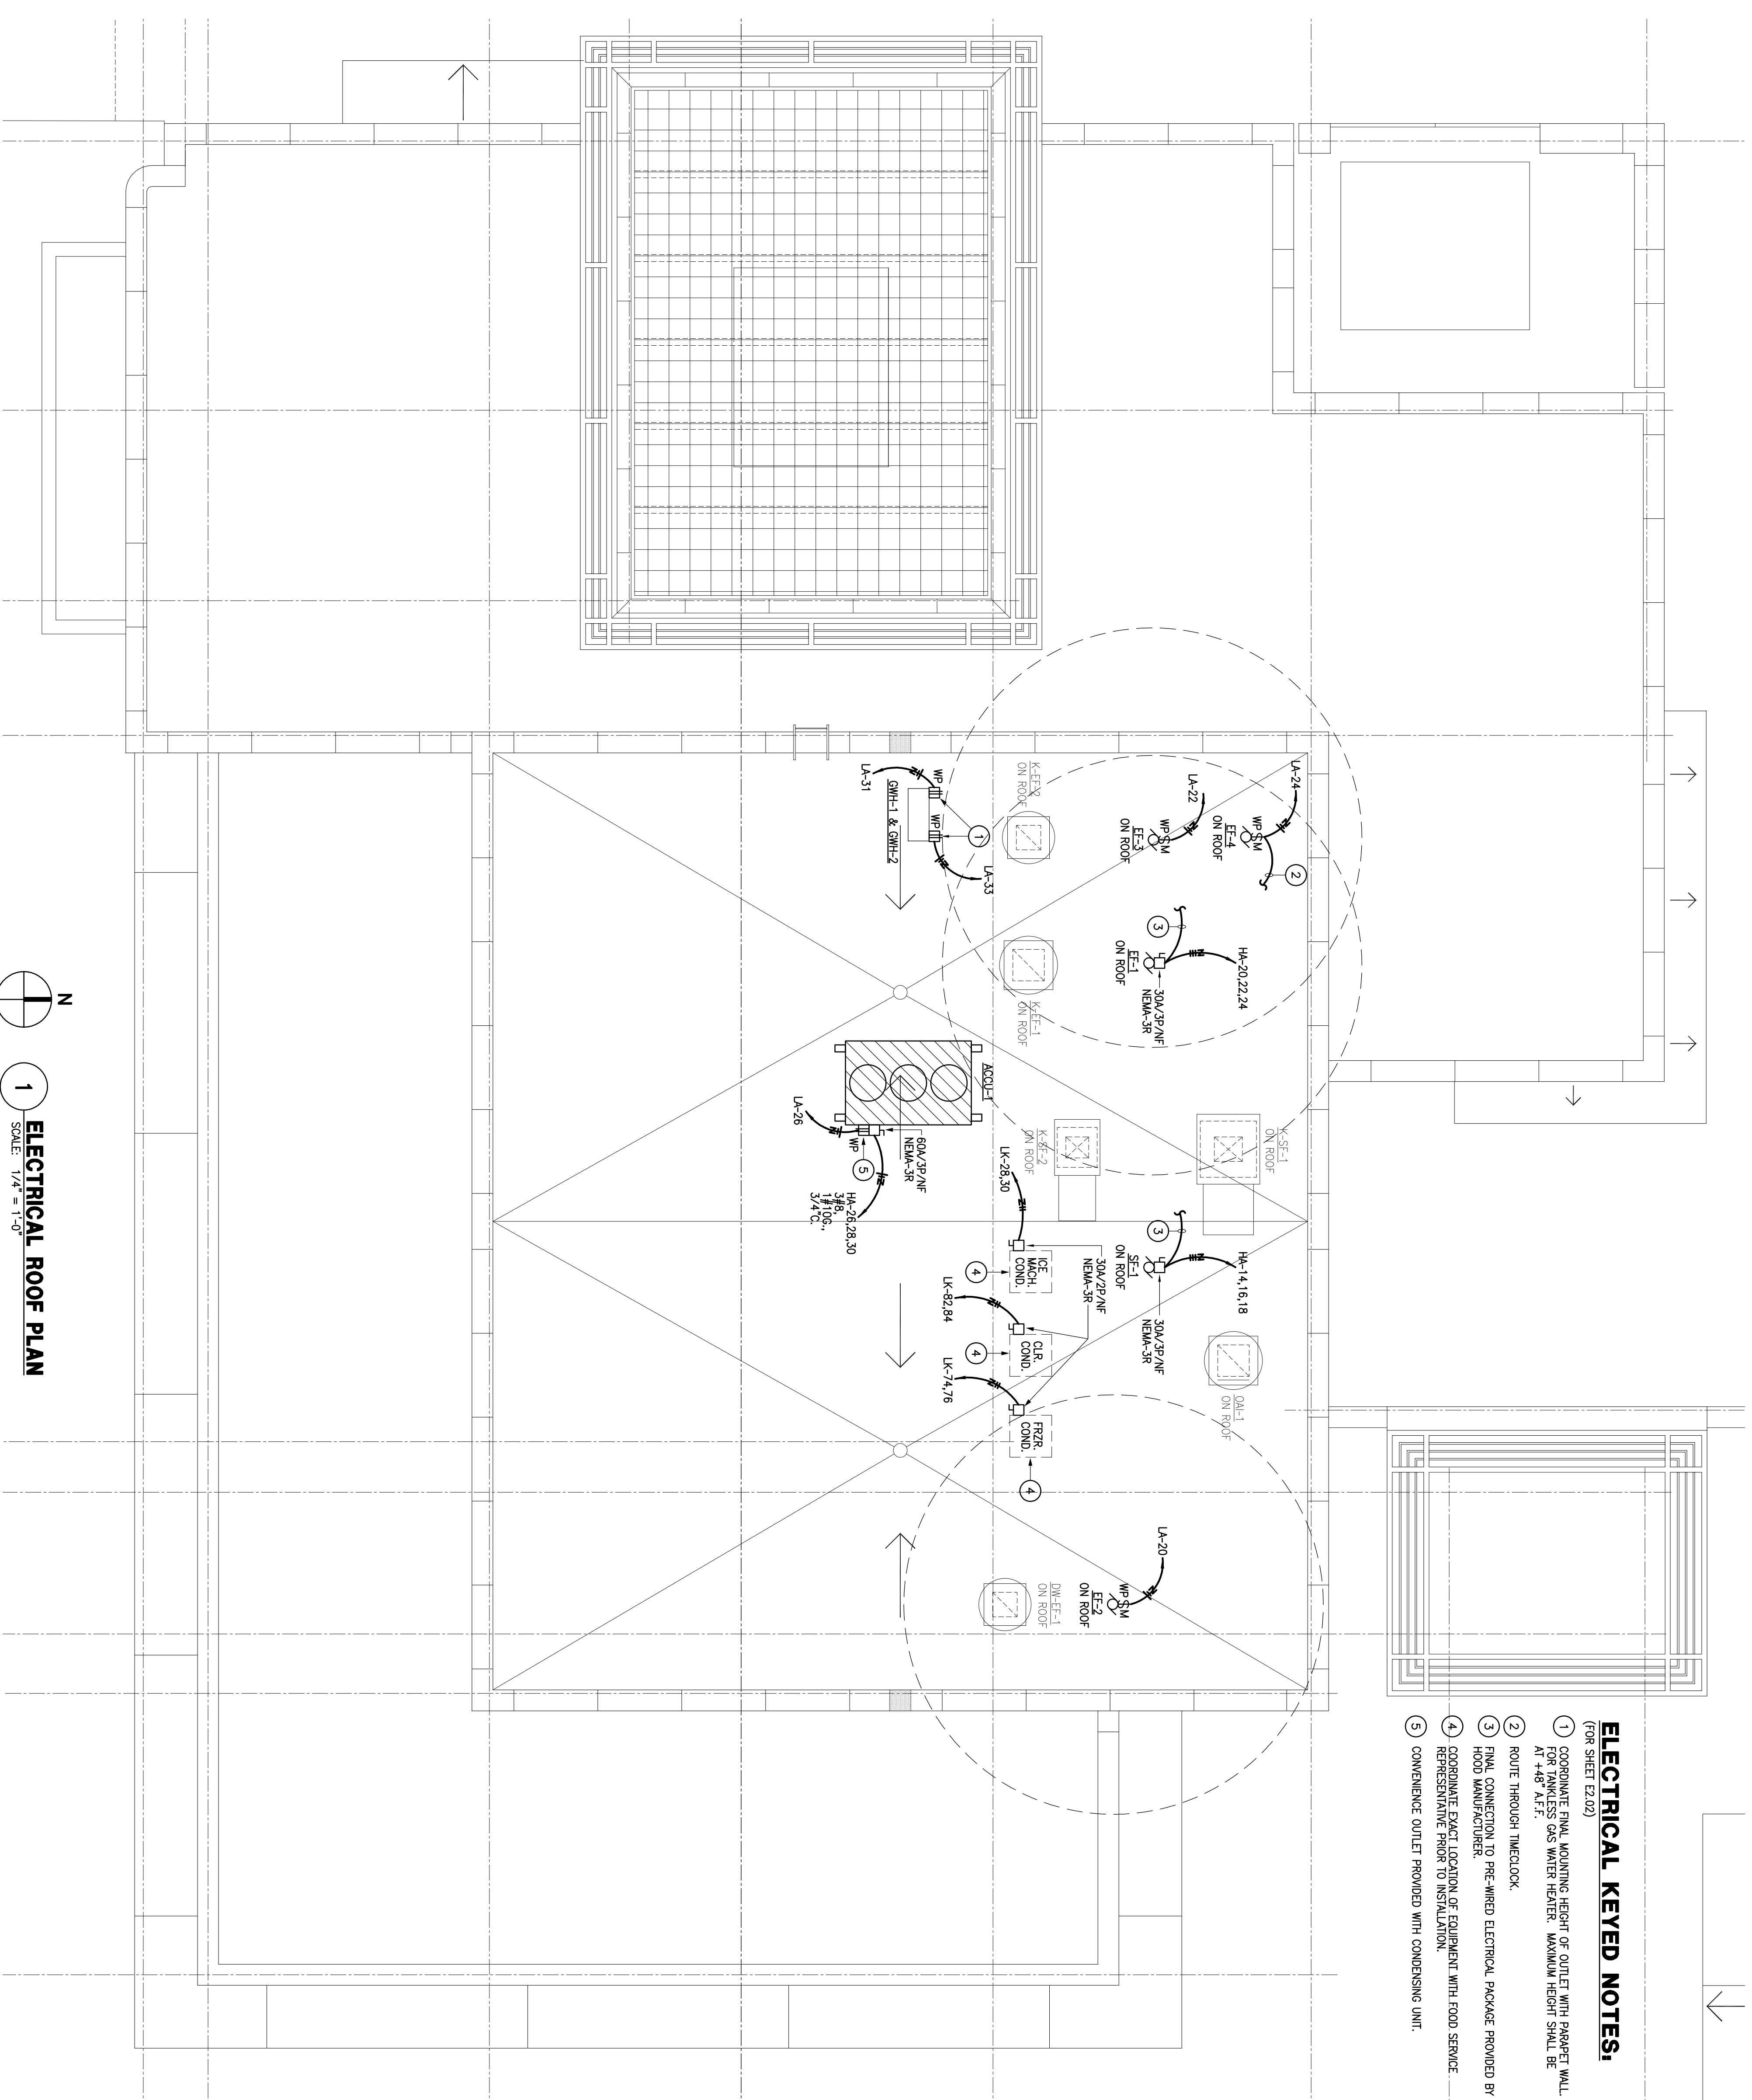

N
1
ELECTRICAL ROOF PLAN
SCALE: 1/4" = 1'-0"

PROJECT NAME
GUADALUPANA
RESTAURANT



PROJECT ADDRESS
29 WATERWAY
THE WOODLANDS, TEXAS

PROJECT NUMBER


SHEET NAME

ELECTRICAL
ROOF PLAN

SHEET NUMBER

CONSULTANTS
HQS SITE & ASSOCIATES
MEP Engineers

HARRELL
ARCHITECTS, LP
9275 Kuhl Fwy., #200
Houston, Texas 77024
tel: 713.722.7071
fax: 713.722.7072

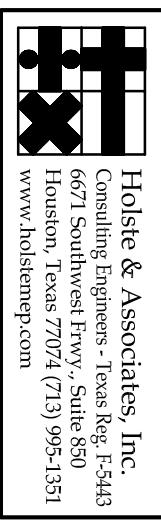

Holbe & Associates, Inc.
Consulting Engineers - Texas Reg. 15443
Mechanical, Electrical, Plumbing
Houston, Texas 77071 (713) 962-1371
www.holbe.com

E2.02