


- NOTES:
1. BOND BEAM PER G.S.N.
 2. MASONRY WALL - FOR TOP OF WALL, SEE ARCH'L.
 3. EXISTING WOOD ROOF JOIST AND STEEL DECK FRAMING. MAINTAIN 1" MAX GAP.
 4. 8"-0" MAX - VERIFY PER ARCH'L.
 5. 3/8" THICK STEEL BENT CLOSURE PLATE - INSTALL IN BETWEEN EXISTING JOISTS.
 6. 2-3/4" DIA. ANCHORS (MIN) PER CLOSURE PLATE; SPACED AT 8" O.C. MIN.
- NOTE:
- A. FOR ADDITIONAL INFORMATION, SEE ARCH'L DRAWINGS.
- B. FILLERS/CALKING AT GAPS PER ARCH'L TO PROVIDE FULL CLOSURE.


110 BOND BEAM AT TOP OF MASONRY WALL 518-02M NO SCALE

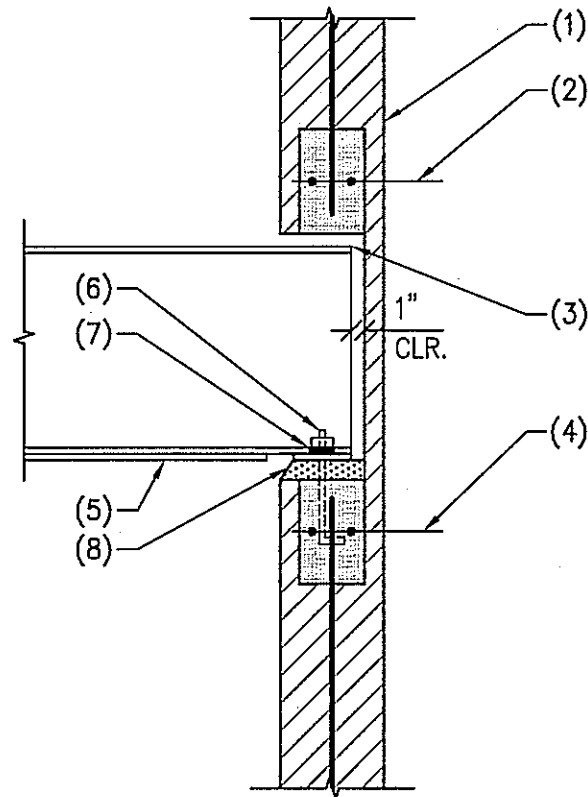

109 STEEL BEAM AT MASONRY WALL 420-01M NO SCALE


- NOTES:
1. MASONRY WALL.
 2. BOND BEAM PER G.S.N.
 3. STEEL BEAM.
 4. 2 #5 x 3'-0" LONG IN 8" DEEP x 4'-0" LONG GROUTED BOND BEAM.
 5. STEEL PLATE PER DETAIL 108.
 6. 2-3/4" DIA. AUTOMATIC WELDED THREADED STUDS ON BEAM GAGE (TIGHTEN NUTS FINGER TIGHT).
 7. 1 1/2" LONG SLOTTED HOLES ON BEAM GAGE - TO RECEIVE STUDS.
 8. 1/2"x4"x8" LONG STEEL BEARING PLATE WITH 2-3/4" DIA ANCHORS OVER 1" ± DRYPACK.
- NOTES:
1. STEEL LINTEL.
 2. MASONRY VENEER TIES.
 3. CONTINUOUS 1/4" x 7 1/2" STEEL PLATE.
 4. USE VENEER TIES AT 16" O.C. HORIZONTALLY AND 8" O.C. VERTICALLY EACH SIDE OF BEAM. WELD TIES TO WEB OF BEAM.
 5. DOWELS TO MATCH AND LAP VERTICAL REINFORCING.
 6. 16" GROUT SOLID ABOVE LINTEL.
 7. INSTALL ON FRESH MORTAR BED.
 8. LINE OF STEEL ROLLING GRILLE. WELD TO PLATE AS SHOWN FOR SUPPORT UNLESS ROLLING GRILLE SUPPORT ATTACHMENT PROVIDED BY GRILLE MANUFACTURER.
 9. LINE OF OPENING WALL BEYOND.

108 ROLLING GRILLE AT STEEL LINTEL IN MASONRY WALL 503-37.02M NO SCALE

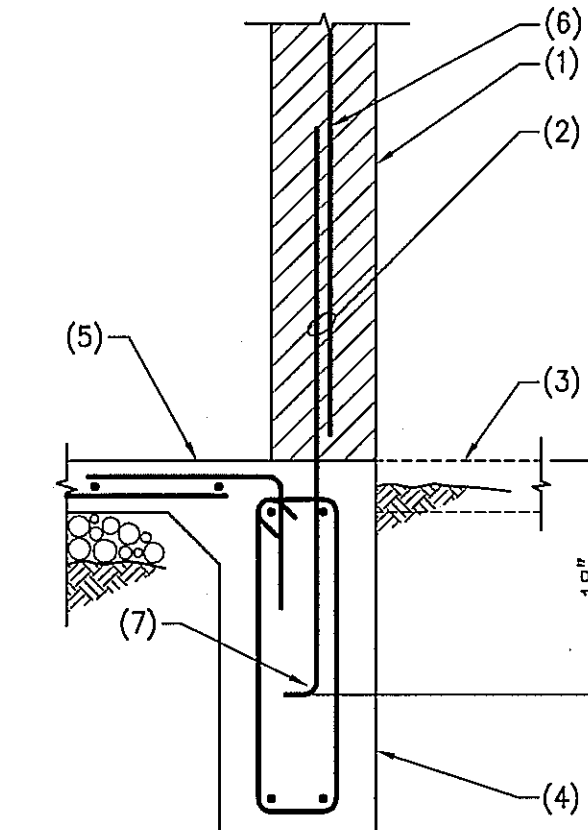


104 MASONRY WALL AT CONCRETE GRADE BEAM 174-11.03M NO SCALE

- NOTES:
1. MASONRY WALL WITH #5 VERTICALS AT 24" O.C. MAX.
 2. DOWELS TO MATCH AND LAP VERTICAL WALL REINFORCING PER G.S.N.
 3. FINISHED GRADE OR CONCRETE SLAB WHERE OCCURS.
 4. CONCRETE GRADE BEAM - SEE DETAIL 101.
 5. CONCRETE SLAB ON GRADE.
 6. #5 VERTICAL REINFORCING AT 24" O.C.
 7. STANDARD HOOK.

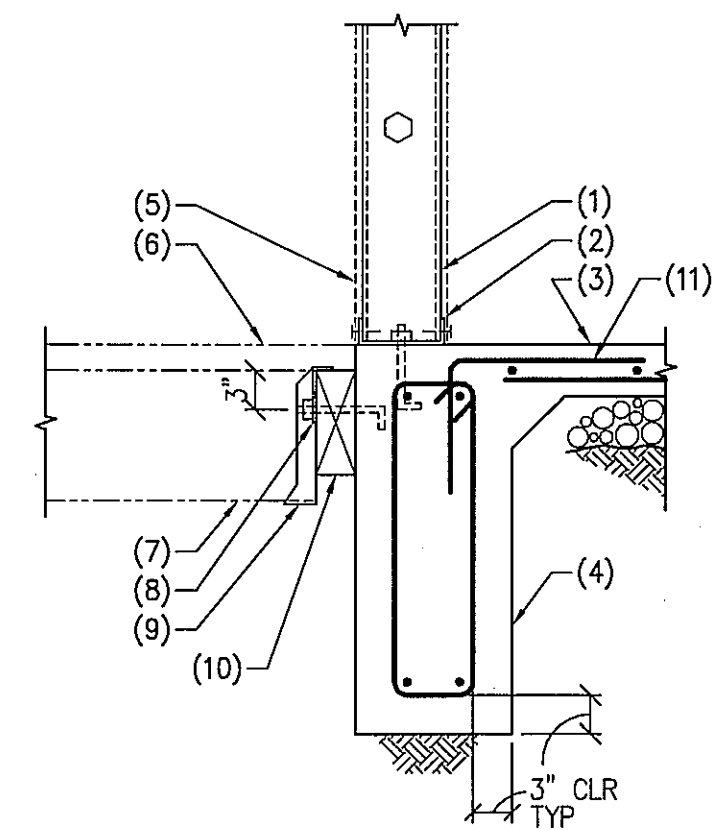



101 NEW STEEL STUD WALL AND EXISTING FLOORING AT GRADE BEAM AND SLAB 10-231 NO SCALE

- NOTES:
1. NEW STEEL STUD WALL 3 5/8"x16 GA (362S162-43) STEEL STUDS AT 24" O.C. MAX.
 2. CONTINUOUS 16 GAGE TRACK WITH 1/2" DIA. ANCHORS AT 24" O.C. MAX AND 2#10 SCREWS EACH STUD.
 3. CONCRETE SLAB ON GRADE.
 4. 12" WIDE X 30" DEEP CONCRETE GRADE BEAM CONTINUOUS AT PERIMETER OF NEW CONCRETE SLAB ON GRADE. INSTALL WITH 4-#5 CONTINUOUS AND #3 STIRRUPS AT 8" O.C.
 5. COVER PER ARCH'L.
 6. EXISTING WOOD BRACING.
 7. EXISTING WOOD JOIST OR BEAM.
 8. SIMPSON HUTT TYPE HANGER.
 9. 2" DIA. STANDARD PLATE WASHER.
 10. CONTINUOUS 3x8 WOOD LEDGER WITH 3/4" DIA. ANCHORS AT 24" O.C. MAX.
 11. #3x24"x16" (SLV) SLAB DOWELS AT 18" O.C.

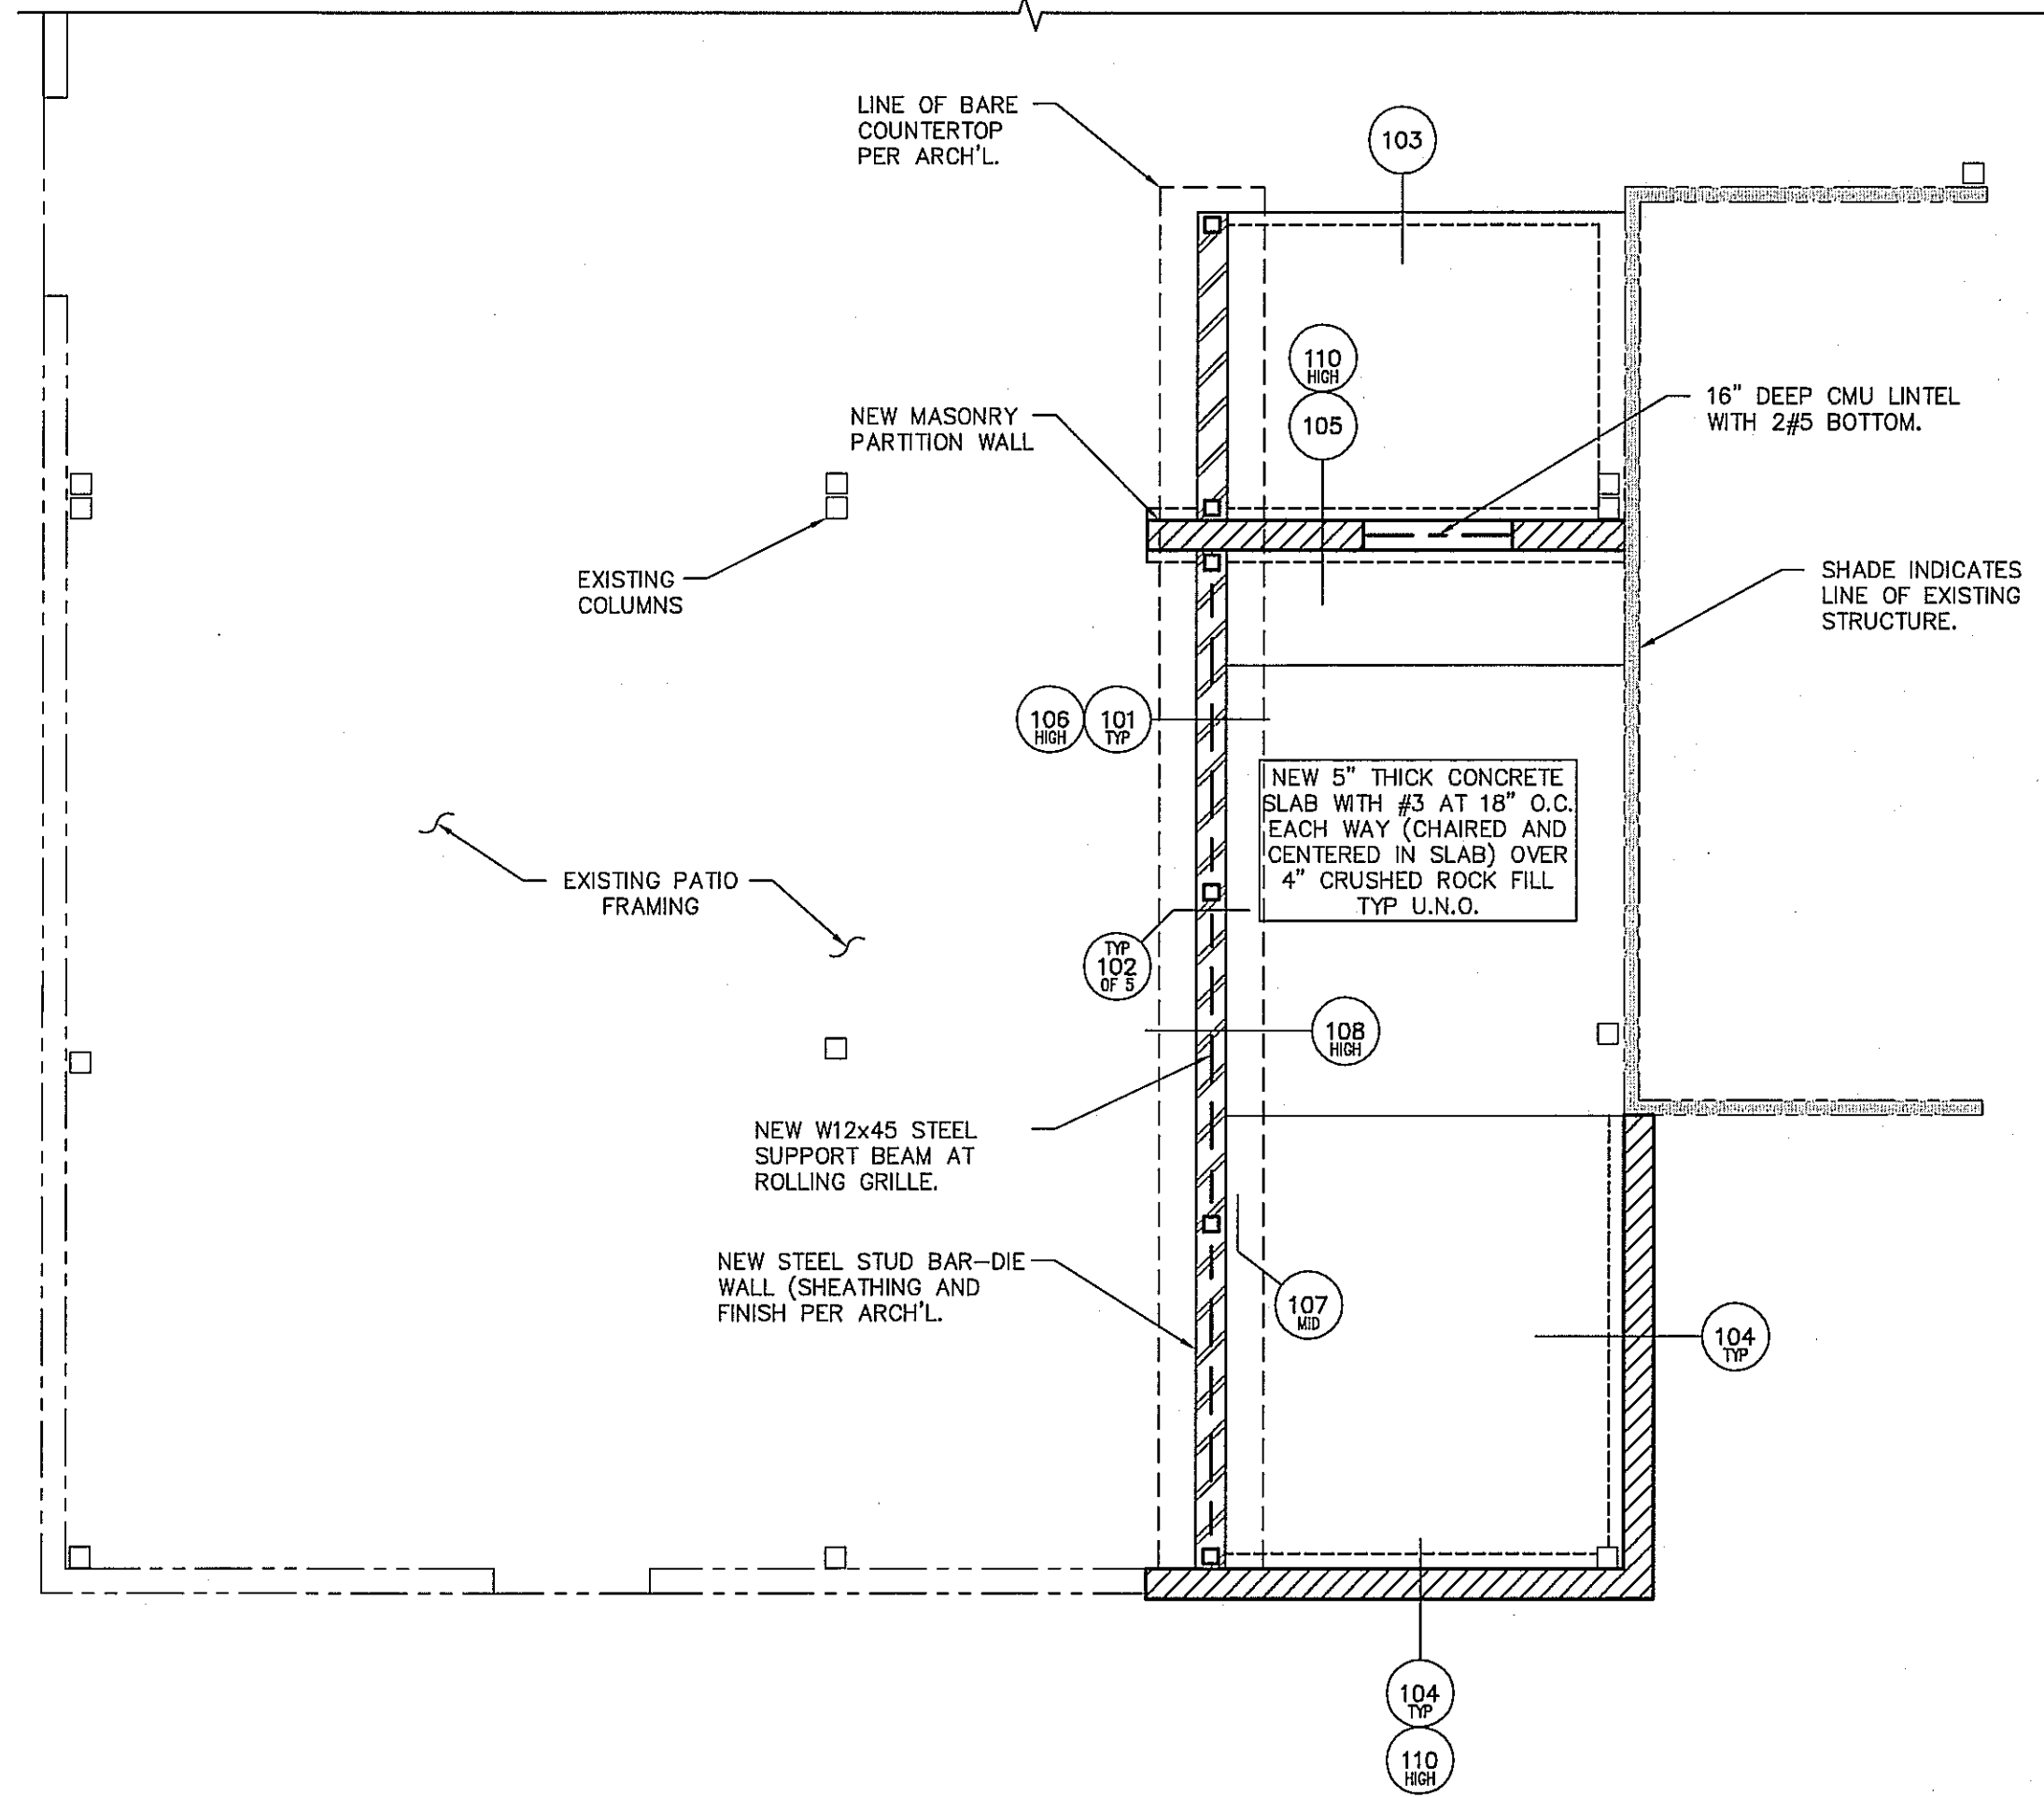


ROLLING GRILLE SUPPORT & FOUNDATION/PATIO FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"

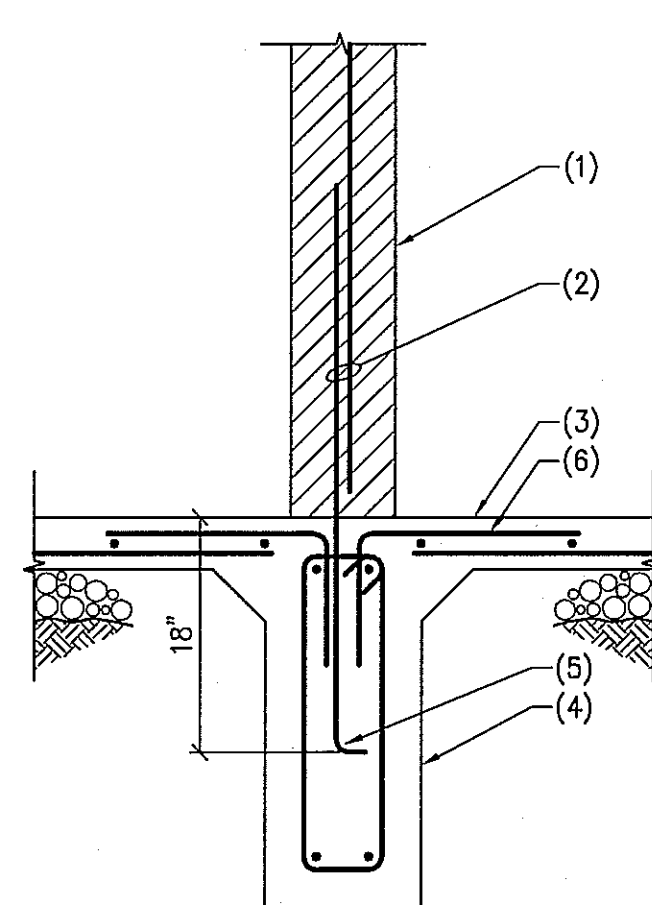


105 MASONRY WALL AT CONCRETE GRADE BEAM 174-11.01M NO SCALE

- NOTES:
1. MASONRY WALL WITH #5 VERTICALS AT 24" O.C. MAX.
 2. DOWELS TO MATCH AND LAP VERTICAL WALL REINFORCING PER G.S.N.
 3. CONCRETE SLAB ON GRADE.
 4. CONCRETE GRADE BEAM - SEE DETAIL 101.
 5. STANDARD HOOK.
 6. SLAB DOWELS PER DETAIL 101.

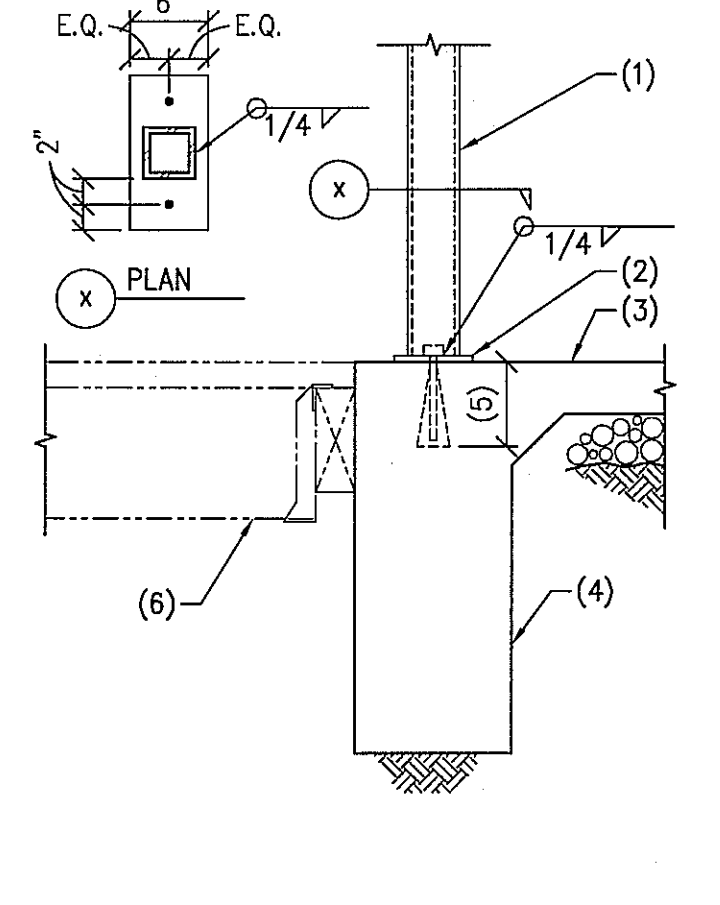


102 NEW SUPPORT POST AT GRADE BEAM 10-231 NO SCALE

- NOTES:
1. HSS 1/2x3 1/2x1/4" STEEL SUPPORT POST AT 7'-0" O.C. MAX.
 2. 1/2" THICK STEEL BASE PLATE WITH 2-3/4" DIA. TITEN HD ANCHORS.
 3. CONCRETE SLAB.
 4. CONCRETE GRADE BEAM.
 5. 1/2" HEBB.
 6. EXISTING ADJACENT PATIO FLOORING.
- NOTE: REFER TO DETAIL 101 FOR INFORMATION SHOWN BUT NOT NOTED.

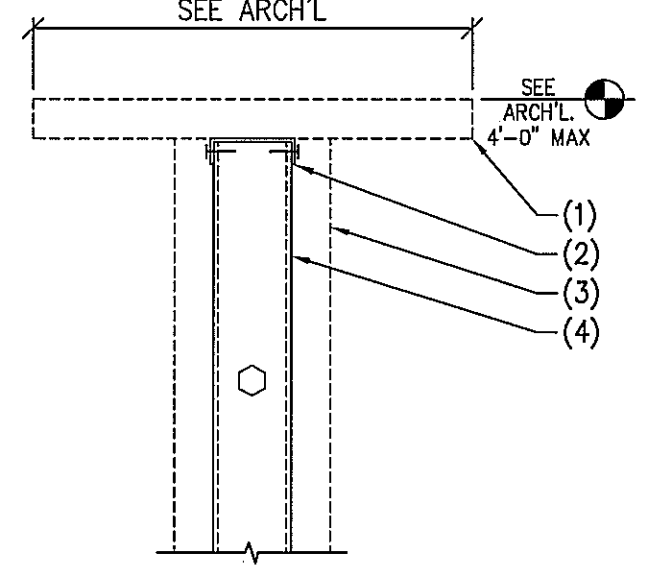


106 TOP CONNECTION AT NEW STEEL STUD WALL 10-231 NO SCALE

- NOTES:
1. LINE OF BAR FINISH AND ATTACHMENT PER ARCH'L.
 2. CONTINUOUS 16 GAGE TRACK WITH 2#10 SCREWS AT EACH STUD.
 3. SHEATHING AND ATTACHMENT PER ARCH'L.
 4. STEEL STUD WALL.

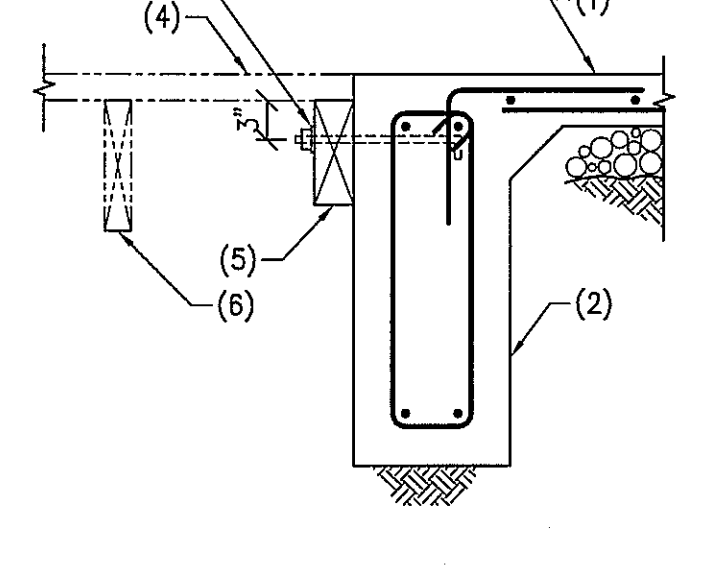

103 EXISTING FLOORING AT GRADE BEAM 10-231 NO SCALE

- NOTES:
1. CONCRETE SLAB ON GRADE.
 2. CONCRETE GRADE BEAM - REFER TO DETAIL 101.
 3. 2" DIA. STANDARD PLATE WASHER.
 4. EXISTING WOOD DECKING.
 5. 3x8 WOOD LEDGER WITH 3/4" DIA. ANCHORS AT 48" O.C. MAX.
 6. EXISTING ADJACENT PATIO FLOOR JOIST.

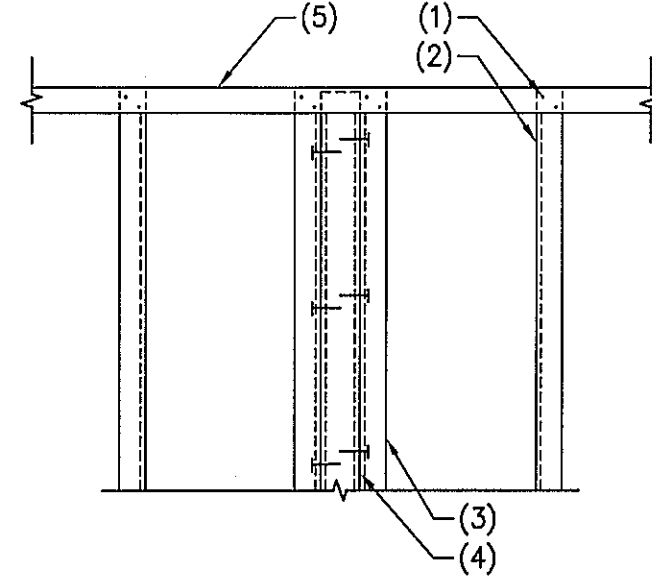

107 ELEVATION - STEEL STUD WALL AT SUPPORT POST 10-231 NO SCALE

- NOTES:
1. 2#10 SCREWS AT EACH STUD.
 2. STEEL STUDS.
 3. INSTALL STEEL STUDS AT STEEL SUPPORT POST W/ HELD X-DRI SHOT PINS AT 12" O.C. MAX CENTERED IN STUD.
 4. STEEL SUPPORT POST.
 5. CONTINUOUS 16 GAGE TRACK.


FOR ADDITIONAL INFORMATION SHOWN BUT NOT NOTED, SEE GENERAL STRUCTURAL NOTES ON SHEET S1.1 AND TYPICAL DETAIL SHEETS.

THESE DRAWINGS/CALCULATIONS ARE CONSIDERED PRELIMINARY - NOT FOR CONSTRUCTION OR RECORDING UNLESS THE STRUCTURAL ENGINEER OF RECORD'S SEAL IS AFFIXED WITH WRITTEN SIGNATURE.

PROJECT NUMBER	10-231	PROJECT MANAGER	CJA
PROJECT ENGINEER	APB	PROJECT DRAFTER	NCR

CARUSO · TURLEY · SCOTT · INC
consulting structural engineers
1215 West Rio Salado Parkway, Suite 200
Tempe, Arizona 85281 (480) 774-1700 (774-1701 FAX)
www.ctscorp.com

bar napkin productions,
2944 n 44th street . suite
phoenix, az 85018
602.492.9494
www.bnpp-llc.com

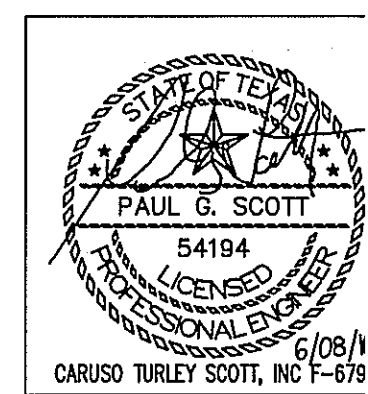

THE OR
NIN

2704 NAVIGATION
HOUSTON, TX

FOUNDA
DET

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF BAR NAPKIN, LLC. THIS DRAWING MAY NOT BE REPRODUCED OR UTILIZED IN ANY MANNER WITHOUT THEIR WRITTEN PERMISSION.