


GENERAL NOTES	
1.	ALL OUTDOOR AIR INTAKES BY MECHANICAL EQUIPMENT SHALL HAVE A MINIMUM 10'-0" HORIZONTAL CLEARANCE FROM THE DISCHARGE OF ANY EXHAUST FAN, COMBUSTION EXHAUST OR PLUMBING VENT.
2.	PROVIDE VIBRATION ISOLATION DEVICES AND FLEXIBLE DUCT/ PIPING CONNECTIONS TO ALL MOVING MACHINERY NOT INTERNALLY ISOLATED.
KEYED NOTES	
①	FACTORY PROVIDED AC UNIT CONTROL PANEL. (VERIFY LOCATION). HACR BREAKER / DISCONNECT SWITCH FURNISHED WITH EQUIPMENT.
2.	VIA STARTER IN MECHANICAL CONTROL PANEL.
3.	VERIFY MOUNTING LOCATION PRIOR TO ROUGH-IN.
4.	GFI SERVICE RECEPTACLE FURNISHED WITH HVAC EQUIPMENT, CIRCUIT ON A-58
5.	VERIFY LOCATION & NUMBER OF SIGNS WITH SIGN VENDOR. RUN SIGN CIRCUITS THROUGH CONTACTOR 'A', CONTROLLED THROUGH PHOTOCELL. SEE DETAIL 8/E2.0. PROVIDE FLUSH MOUNTED WP J-BOX IN EXTERIOR FACE OF WALL.
6.	ELECTRICAL CONTRACTOR SHALL RUN CONTROL WIRING TO ROOF TOP UNITS, SENSORS, AND THERMOSTATS. COORDINATE WITH MECHANICAL CONTRACTOR.
7.	CONDENSATE DRAIN PIPING FROM THE HVAC UNIT SHALL BE ROUTED ON THE ROOF AS SHOWN, AT A MINIMUM PITCH OF 1/4" PER FOOT IN THE DIRECTION OF FLOW. REFER TO THE PLUMBING DWG PLAN FOR CONTINUATION OF CONDENSATE DRAINAGE PIPING BELOW THE ROOF.
8.	GAS PIPING TO THE MECHANICAL UNIT SHALL TURN BACK THROUGH THE ROOF CURB. PROVIDE WEATHER TIGHT SEAL AT PIPE PENETRATION. REFER TO THE WATER AND GAS PLUMBING PLAN FOR CONTINUATION OF PIPING BELOW THE ROOF.
9.	ALL PIPING INSTALLED ON THE ROOF SHALL BE SUPPORTED WITH PRE-MANUFACTURED ADJUSTABLE PIPE SUPPORTS AT MAXIMUM 5'-0" ON CENTER AND EVERY CHANGE OF DIRECTION.
10.	CONCENTRIC VENT COMBUSTION AIR INTAKE/ EXHAUST FLUE FOR THE GAS FIRED WATER HEATER. COORDINATE ROOF PENETRATION, FLASHING AND COUNTER-FLASHING WITH THE GENERAL CONTRACTOR.
11.	ROOF MOUNTED VTR, SIZED AS SHOWN. INSTALLED LOCATION SHALL BE A MINIMUM OF 10'-0" FROM ANY OUTDOOR AIR INTAKE. TOP OF VTR STACK SHALL BE EVEN WITH PARAPET WALL. INSTALL COMPLETE WITH ODOR EATER CAP AS SCHEDULED.
12.	FIELD FABRICATED ROOF JACK FOR REFRIGERATION PIPING AND POWER CONDUIT(S) SHALL BE PROVIDED BY THE GENERAL CONTRACTOR. REFER TO ARCHITECTURAL DETAILS FOR DIRECTION. THE MC, EC AND GC SHALL COORDINATE FOR A COMPLETE INSTALLATION.
13.	PROVIDE WEATHER PROOF VENT CAP FOR TERMINATION OF RESTROOM EXHAUST. INSTALL COMPLETE WITH 1/4"x1/4" WIRE MESH SCREEN.

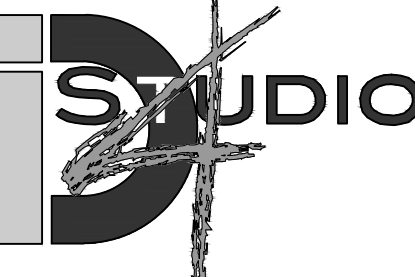


**ID STUDIO 4, LLC**  
1431 GREENWAY DR, SUITE 150  
IRVING, TEXAS 75038  
TEL: 972.870.1288  
WWW.IDSTUDIO4.COM

CLIENT:

**FOCUS Brands**  
301 S. CONGRESS AVE., STE 11000  
AUSTIN, TX 78701  
512.236.3600  
www.focusbrands.com

TBPE FIRM REGISTRATION# F-11678




NOT FOR CONSTRUCTION/  
BRIAN EDWARD CHANDLER  
83800  
B. Chandler

12-15-11

**SCHLOTZSKY'S DELI**  
**THE TRAILS AT 620**  
8300 N. FM 620 STE 103  
AUSTIN, TX. 78726

CLIENT: FOCUS Brands  
301 S. CONGRESS AVE. STE 11000  
AUSTIN, TX 78701



DATE	DESCRIPTION
11.21.11	ISSUE FOR PERMIT
12.16.11	ISSUE FOR BID

DATE	DESCRIPTION
2	12.15.11 BUILDING CHANGES

SHEET TITLE:

**MEP**  
**ROOF PLAN**

SHEET NUMBER:

**MEP1.0**

PROJECT NUMBER:

**FOC11003**