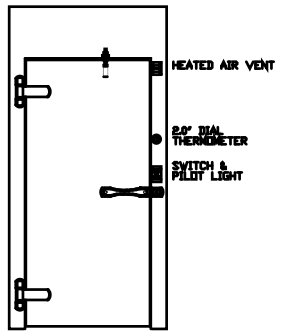

DOOR 94575A04040404
THRESHOLD DETAIL 02
46x94.25DS 34x78 DR LH STD FZR
FRAME=GL/GL PLUG=GL/GL

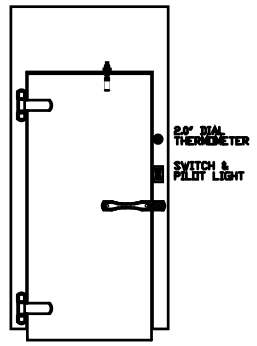

DOOR 94575B04040404
THRESHOLD DETAIL 50
46x94.25DS 34x78 DR LH SCD CLR
FRAME=GL/GL PLUG=GL/GL

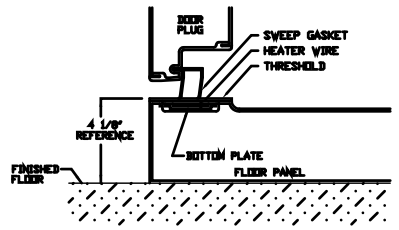

STANDARD WITH FLOOR FREEZER
DETAIL (02)

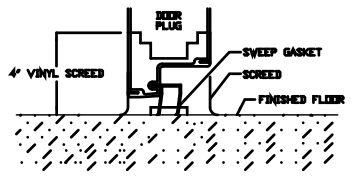

FLOORLESS COOLER WITH
4" VINYL FOAM SCREED
DETAIL (50)

DO NOT USE this drawing for installation

IMPORTANT NOTES:

1) MANITOWOC RECOMMENDS A MINIMUM AIRFLOW AROUND THE WALK-IN, OF 5 CFM PER 100 SQ. FT. OF WALL AREA TO MINIMIZE CONDENSATION.
2) WALK-IN CEILING IS NOT DESIGNED FOR FOOT TRAFFIC OR STORAGE.
3) GENERAL CONTRACTOR TO REFER TO DESIGN AND SPECIFICATIONS MANUAL FOR FLOOR DETAIL INFORMATION.
4) SPECIAL NOTE TO GENERAL CONTRACTOR AND SUBCONTRACTOR FOR QUARRY TILE OR CONCRETE WEARING FLOOR - THE SHEET METAL PANEL FACINGS MAY BE SUSCEPTABLE TO STAINING DUE TO EXCESSIVE MOISTURE CREATED BY THE HYDRATION OF CONCRETE TYPE MATERIALS. THEREFORE, IT IS ABSOLUTELY NECESSARY THAT EACH ROOM BE PROPERLY VENTILATED. ALSO NOTE THAT SPECIAL PRECAUTIONS MUST BE TAKEN WHEN USING MURIC ACID DUE TO EFFECTS HYDROCHLORIC ACID FUMES HAVE ON ALUMINUM AND STAINLESS STEEL MATERIALS.
5) THIS DRAWING IS FOR APPROVAL PURPOSES ONLY AND IS NOT TO BE USED FOR INSTALLATION OF THIS WALK-IN. AN "AS-BUILT" DRAWING IS PROVIDED WITH EACH SHIPPED WALK-IN.

SIGNED APPROVED PRINT MUST BE REC'D. B/4 FAB.

☐☐ APPROVED AS DRAWN
APPROVED AS NOTED
NOT APPROVED RESUBMIT

SIGNED_____

DATE_____

PLEASE VERIFY WALL HEIGHTS, ALL DIMENSIONS AND METAL FINISHES BEFORE APPROVING DRAWING.

SYM	REVISION	BY	DATE

DRAWING NO. 94575

Kolpak
2915 TENNESSEE AVENUE NORTH
P.O. BOX 550
PARSONS, TN. 38363
(731) 847-6361

DRAWN: KES
CUSTOMER: CONCEPT SERVICES
CHECKED: SHW
PROJECT: SCHLOTZSKY - WILLIS, TX
DATE: 5/12/2011
SCALE: 3/8"=1'-0"
SHEET: 1 OF: 2